

Evidence of performance
Airborne sound insulation building components

Test Report

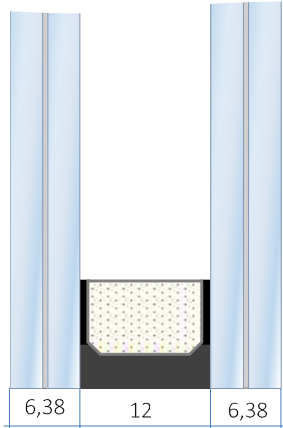
No. GLA-1255.1/16

Client:**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

| | |
|-----------------------|--|
| <i>Product:</i> | Insulating glass unit |
| <i>Construction:</i> | 33.1 / 12 / 33.1 |
| <i>Designation:</i> | Laminated glass 33.1 class 2B2 / 12+Ar / Laminated glass 33.1 class 2B2 |
| <i>Dimension:</i> | 1230mm x 1480mm |
| <i>Gas filing:</i> | Argon |
| <i>Cross-section:</i> |  |

| <i>Rating</i> | R_w (C; C_{tr}) | STC | OITC |
|---------------|--|--------------|---------------|
| <i>Basis</i> | PN-EN ISO 717-1: 2013 | ASTM E413-10 | ASTM E1332-10 |
| <i>Value</i> | 35 (-2; -6) dB | 35 dB | 27 dB |

Łozienica, 27.04.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory