

**Evidence of performance**  
**Airborne sound insulation building components**

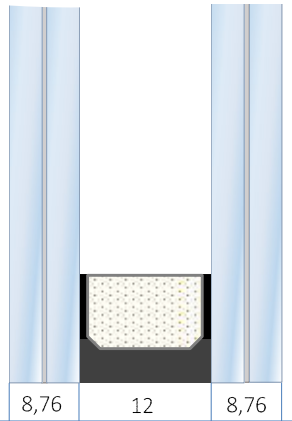
Test Report

**No. GLA-1255.2/16**Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	44.2 / 12 / 44.2
Designation:	Laminated glass 44.2 class P2A / 12+Ar / Laminated glass 44.2 class P2A
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

<i>Rating</i>	<b>R<sub>w</sub> (C; C<sub>tr</sub>)</b>	<b>STC</b>	<b>OITC</b>
<i>Basis</i>	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
<i>Value</i>	<b>38 (-2; -6) dB</b>	<b>38 dB</b>	<b>30 dB</b>

Łozienica, 05.05.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory