

Evidence of performance
Airborne sound insulation building components

Test Report

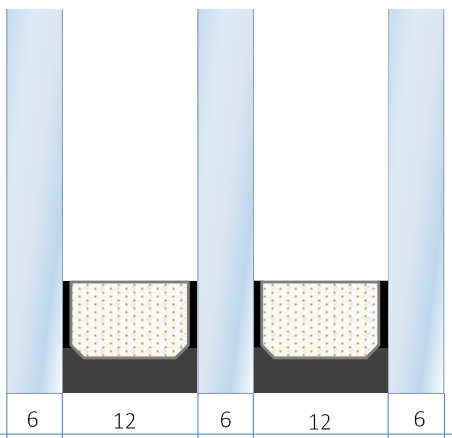
No. GLA-1255.7/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	6 / 12 / 6 / 12 / 6
Designation:	FL 6 / 12+Ar / FL 6 / 12+Ar / FL 6
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	R_w (C; C_{tr})	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	35 (-2; -7) dB	35 dB	25 dB

Łozienica, 05.05.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory