

**Evidence of performance**  
**Airborne sound insulation building components**

Test Report

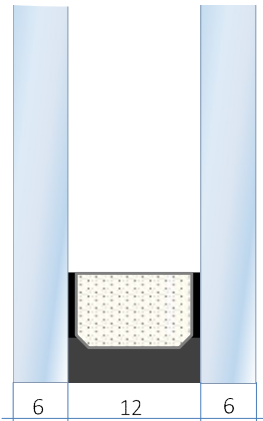
No. GLA-1255.8/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	6 / 12 / 6
Designation:	FL 6 / 12+Ar / FL 6
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

<i>Rating</i>	<b>R<sub>w</sub> (C; C<sub>tr</sub>)</b>	<b>STC</b>	<b>OITC</b>
<i>Basis</i>	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
<i>Value</i>	<b>33 (-1; -5) dB</b>	<b>33 dB</b>	<b>26 dB</b>

Łozienica, 05.05.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory