

Evidence of Performance

Airborne sound insulation of building components

Test Report

No. 15-001724-PR01

(PB 6-H01-04-en-01)




Client **PRESS GLASS SA**
Nowa Wies
Kopalniana 9
42-262 Poczesna
Poland

Basis

EN ISO 10140-1: 2010
+A1: 2012 + A2:2014
EN ISO 10140-2: 2010
EN ISO 717-1: 2013

Product	Insulating glass unit
Designation	FL6+12+44.1 (SR) Ar
Overall dimension (w x h)	1,230 mm x 1,480 mm
Construction	6 / 12 / 8 LSG SR
Gas filling	Argon
Area related weight	34.8 kg/m ²
Specials	-/-
Client	

Representation

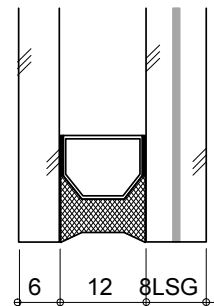

Instructions for use

This test report serves to demonstrate the airborne sound insulation of a building component.

Applicable for Germany
 R_w corresponds to $R_{w,F}$ for DIN 4109 Annex 1 Table 40

Weighted sound reduction index R_w
Spectrum adaptation terms C and C_{tr}



$$R_w (C; C_{tr}) = 40 (-2; -6) \text{ dB}$$

Validity

The data and results given relate solely to the tested and described specimen.

Testing the sound insulation does not allow any statement to be made on any further characteristics of the present construction regarding performance and quality.

ift Rosenheim
19.06.2015

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics

Bernd Saß, Dipl.-Ing. (FH)
Deputy Head of Testing Department
Building Acoustics

Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

The cover sheet can be used as an abstract.

Contents

The test report contains a total of 7 pages:

- 1 Object
 - 2 Procedure
 - 3 Detailed results
 - 4 Instructions for use
- Data sheet (1 page)